




FORMATO DE DATOS MENSUAL DE LOS EQUIPOS SECUENCIALES (PARTISOL) PM10 CORT SEPTIEMBRE 20-29

Fecha dd/mm/aa	Numero de filtro	W Filt limp (g)	W Filt usado (g)	W test inic (g)	W test final (g)	PTP (g)	Volumen (m3 ref)	Concentración (Ug/m3 ref) con	Act Start Time	Set Stop Time	Ilo	Ihi	Bplo	Bphi	ICA
20/09/2010	P0000066	0,15123	0,15220	0,79033	0,79042	0,0008800	24,0480	37	00:00	00:00	0	50	0	54	33,88
23/09/2010	P0000067	0,15022	0,15115	0,79033	0,79042	0,0008400	24,0480	35	00:00	00:00	0	50	0	54	32,34
26/09/2010	P0000068	0,14842	0,14915	0,79033	0,79042	0,0006400	24,0480	27	00:00	00:00	0	50	0	54	24,64
29/09/2010	P0000069	0,14915	0,15005	0,79033	0,79042	0,0008100	24,0480	34	07:00	07:00	0	50	0	54	31,19

Concentración

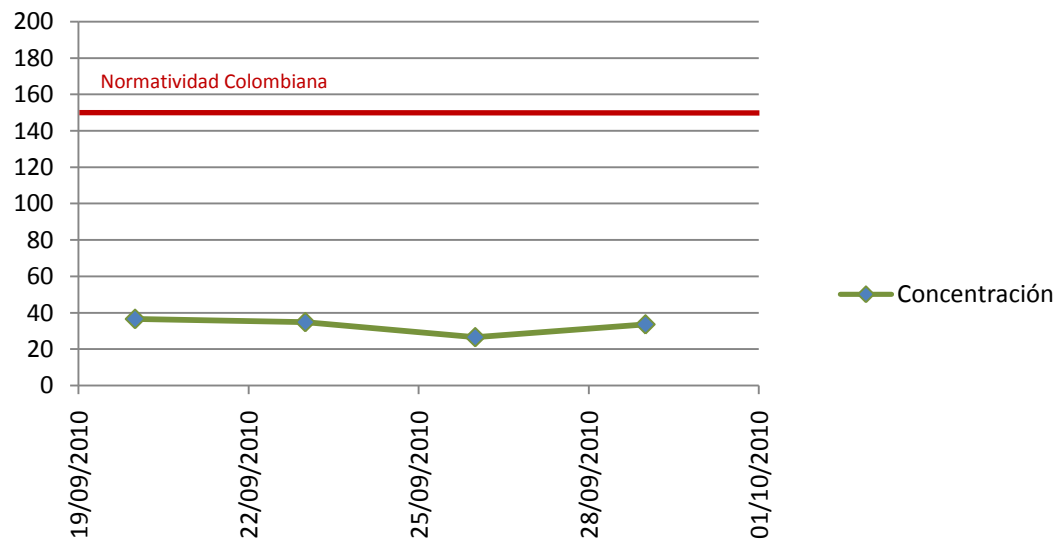

ICA

